



INCORPORATED VILLAGE OF OCEAN BEACH

P.O. BOX 457, OCEAN BEACH, NEW YORK 11770-0457
TEL: (631) 583-5940 FAX: (631) 583-7597

MUST BE RENEWED EVERY THREE YEAR PERIOD
MUST BE RENEWED ANYTIME NEW PROPERTY OWNER


2017 COMMERCIAL AND RESIDENTIAL PROPANE USE PERMIT APPLICATION

FEE: \$50.00 RESIDENTIAL \$100.00 COMMERCIAL

- OWNER : _____
- PROPERTY ADDRESS: _____
- OWNER PHONE NUMBER: _____
- APPROVED PROPANE HANDLER: _____
- PROPANE HANDLER PHONE NUMBER: _____
- SIZE & NUMBER OF TANKS: _____

➤ **THERE ARE NO PROPANE TANKS AT THIS LOCATION:** _____

OWNER SIGNATURE

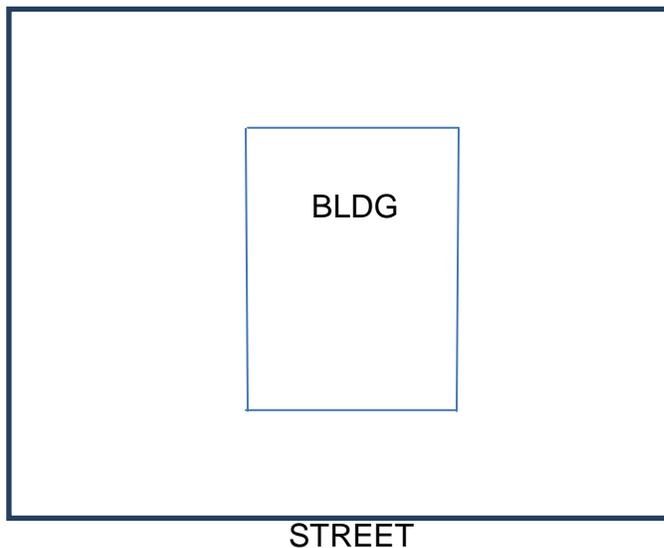

MAP OF LOCATION OF TANK(S)

BUILDING INSPECTOR / FIRE MARSHAL SIGNATURE UPON APPROVAL AFTER FIELD INSPECTION:

INSTRUCTIONS

By applying for this permit, the property owner, tenant, plumber and propane handler agree to abide by all applicable laws and regulations, including all building and plumbing codes, and the code of the Inc. Village of Ocean Beach, including the following. All dimensions below are from tank valve.

1. PLEASE NOT THAT NO RENTAL PERMITS WILL BE GRANTED WITHOUT THIS APPLCIATION RECEIVED, ANY WORK REQUIRED COMPETED AND A FINAL APPROVED INSPECTION.
2. All tanks shall be on a firm foundation, not soil, sand or gravel. Decay resistant wood decks are acceptable but must be checked periodically.
3. All tanks shall be anchored securely to resist floatation and tipping due to high winds. Do not use chains that may scratch the protective coating/paint off the tank and compromise the corrosion protection or the valve stems.
4. All tanks shall have 6 feet vertical clearance from all electrical lines.
5. All exchange tanks shall be located no closer than 3 feet to any vents or windows. On site fillable tanks require 5 feet.
6. All exchange tanks shall be located no closer than 5 feet from ignition sources such as electrical disconnect switches, air conditioners (including window) and condenser units, direct vent intake and exhaust. On site fillable tanks require 10 feet clearance.
7. Shutoffs within 6 feet of each appliance.
8. Underground gas piping minimum 12" deep.
9. There shall be a flexible pipe at the connection to the tank(s). Maximum length 60".
10. Corrugated Stainless Steel Tubing CSST shall be sleeved, electrically bonded to ground and properly secured.
11. Fillable tank life is 12 years from date of manufacture. Afterward, tanks shall be recertified by the supplier via a hydro test or approved equal. Tanks shall be visually checked by a qualified person every year in the field nevertheless.
12. Label servicer name on tanks.
13. All abandoned tanks shall be removed from the site and disposed of appropriately ASAP.
14. Pressure test required at inspection. Valves to be opened to avoid damage.
15. Permit expires upon new ownership or tenancy of the property or building.
16. This permit does not pertain to BBQ propane tanks.
17. This permit is calendar year only.

NOTARY PUBLIC

STATE OF NEW YORK)
COUNTY OF SUFFOLK) SS.: _____ being duly sworn
(PRINT) NAME OF INDIVIDUAL SIGNING APPLICATION

deposes and says that he/she is the applicant above named. He/She is the _____
OWNER

and is duly authorized to perform the said work and to make and file this application; that all statements contained in this application are true to the best of his/her knowledge and belief; and that the work will be performed in the manner set forth in this application for permit and maintained accordingly with periodic inspections.

_____ Sworn to before me this
OWNER SIGNATURE _____ day of _____, 201

NOTARY PUBLIC

FOR OFFICE USE ONLY

Date Application Received: _____ Fee Paid: _____ Cash Receipt No. _____